
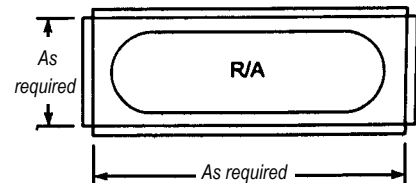


NOTES:

1. INSTALL INSULATED ADAPTER PANS BEFORE A/C UNIT IS PLACED ON CURB.
2. FIELD BAFFLES MAY BE REQUIRED FOR BALANCING.
3. CONCENTRIC CONVERTER BOX MUST BE FIELD SUPPORTED.

DUCT SIZE	2 - 20"
SUPPLY GRILLE SIZE	2 - 42" X 4" 2 - 24" X 4"
NOMINAL CFM	3000
THROW IN FT.	MIN: 22' MAX: 32'

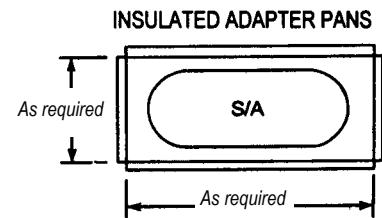

Job Name _____

Location _____

Architect _____

Engineer _____

Contractor _____

DRAWN BY:
RLT

DATE:
09-01-00

REV. DATE:
07-05-06

REV. NO.:
2

APPROVED BY:
BT

DWG NO.:
I-12