


- NOTES:**
1. INSTALL INSULATED ADAPTER PANS BEFORE A/C UNIT IS PLACED ON CURB.
  2. FIELD BAFFLES MAY BE REQUIRED FOR BALANCING.
  3. CONCENTRIC CONVERTER BOX MUST BE FIELD SUPPORTED.

DUCT SIZE	2 - 20"
SUPPLY GRILLE SIZE	2 - 42" X 4" 2 - 24" X 4"
NOMINAL CFM	3000
THROW IN FT.	MIN: 22' MAX: 32'

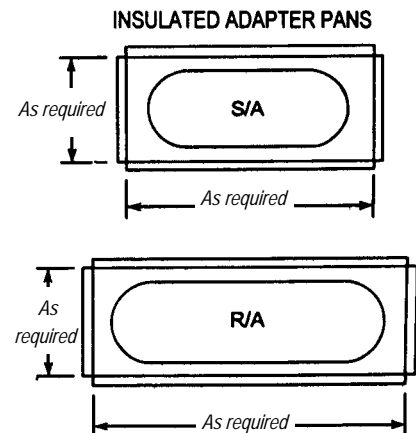

Job Name \_\_\_\_\_  
 Location \_\_\_\_\_  
 Architect \_\_\_\_\_  
 Engineer \_\_\_\_\_  
 Contractor \_\_\_\_\_

<b>DRAWN BY:</b> RLT	<b>DATE:</b> 09-01-00	<b>REV. DATE:</b> 07-05-06
<b>REV. NO.:</b> 2	<b>APPROVED BY:</b> BT	<b>DWG NO.:</b> I-12