


- NOTES:**
1. INSTALL INSULATED ADAPTER PANS BEFORE A/C UNIT IS PLACED ON CURB.
 2. FIELD BAFFLES MAY BE REQUIRED FOR BALANCING.
 3. CONCENTRIC CONVERTER BOX MUST BE FIELD SUPPORTED.

DUCT SIZE	2 - 20"
SUPPLY GRILLE SIZE	2 - 42" X 4" 2 - 24" X 4"
NOMINAL CFM	3000
THROW IN FT.	MIN: 22' MAX: 32'

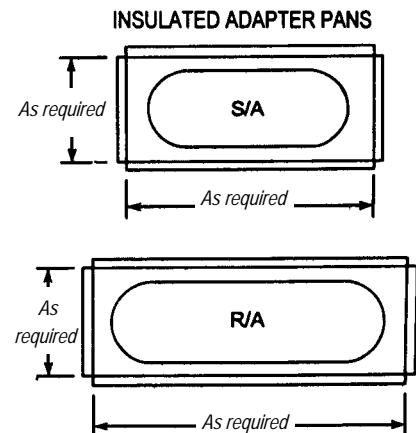

Job Name _____
 Location _____
 Architect _____
 Engineer _____
 Contractor _____

DRAWN BY: RLT	DATE: 09-01-00	REV. DATE: 07-05-06
REV. NO.: 2	APPROVED BY: BT	DWG NO.: I-12